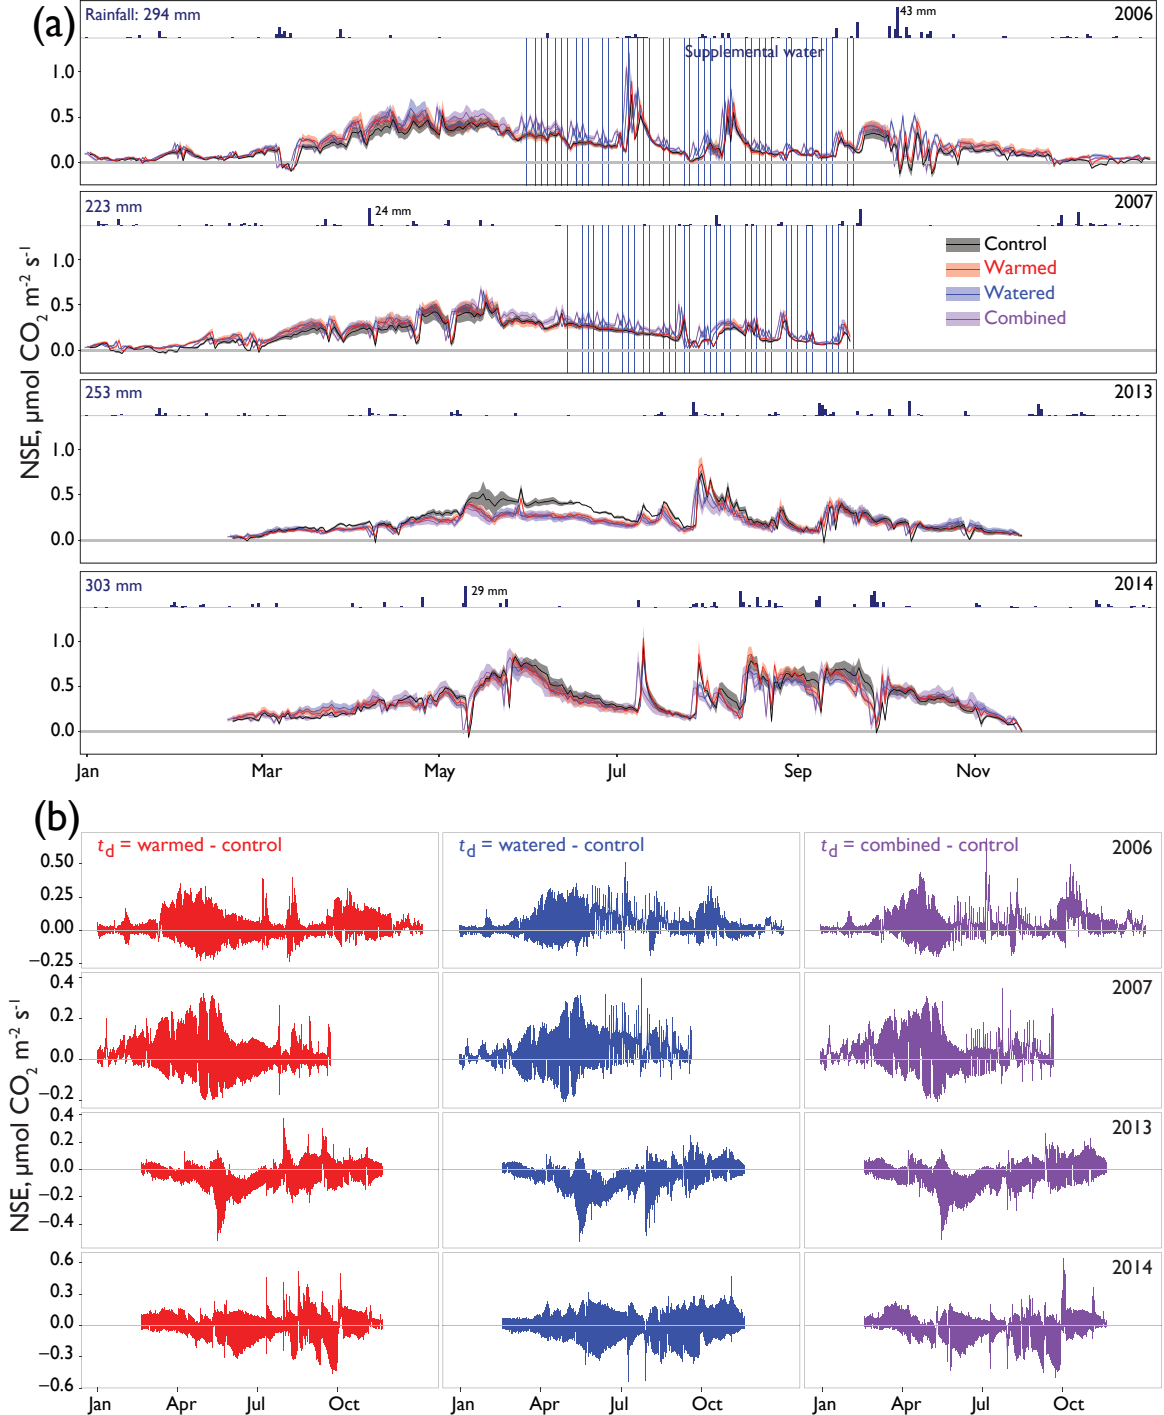
(a)
Rainfall: 294 mm
43 mm
2006
Supplemental water
223 mm
24 mm
2007
Control
Warmed
Watered
Combined
253 mm
2013
303 mm
29 mm
2014
NSE, µmol CO2 m-2 s-1
Jan
Mar
May
Jul
Sep
Nov
(b)
td = warmed - control
td = watered - control
td = combined - control
2006
2007
2013
2014
NSE, µmol CO2 m-2 s-1
Jan
Apr
Jul
Oct